


G. ROBERT GEORGE & ASSOCIATES, INC. CONSULTING ENGINEERS P.O. BOX 12328, CHARLESTON, SOUTH CAROLINA 29412 (803) 556-4261

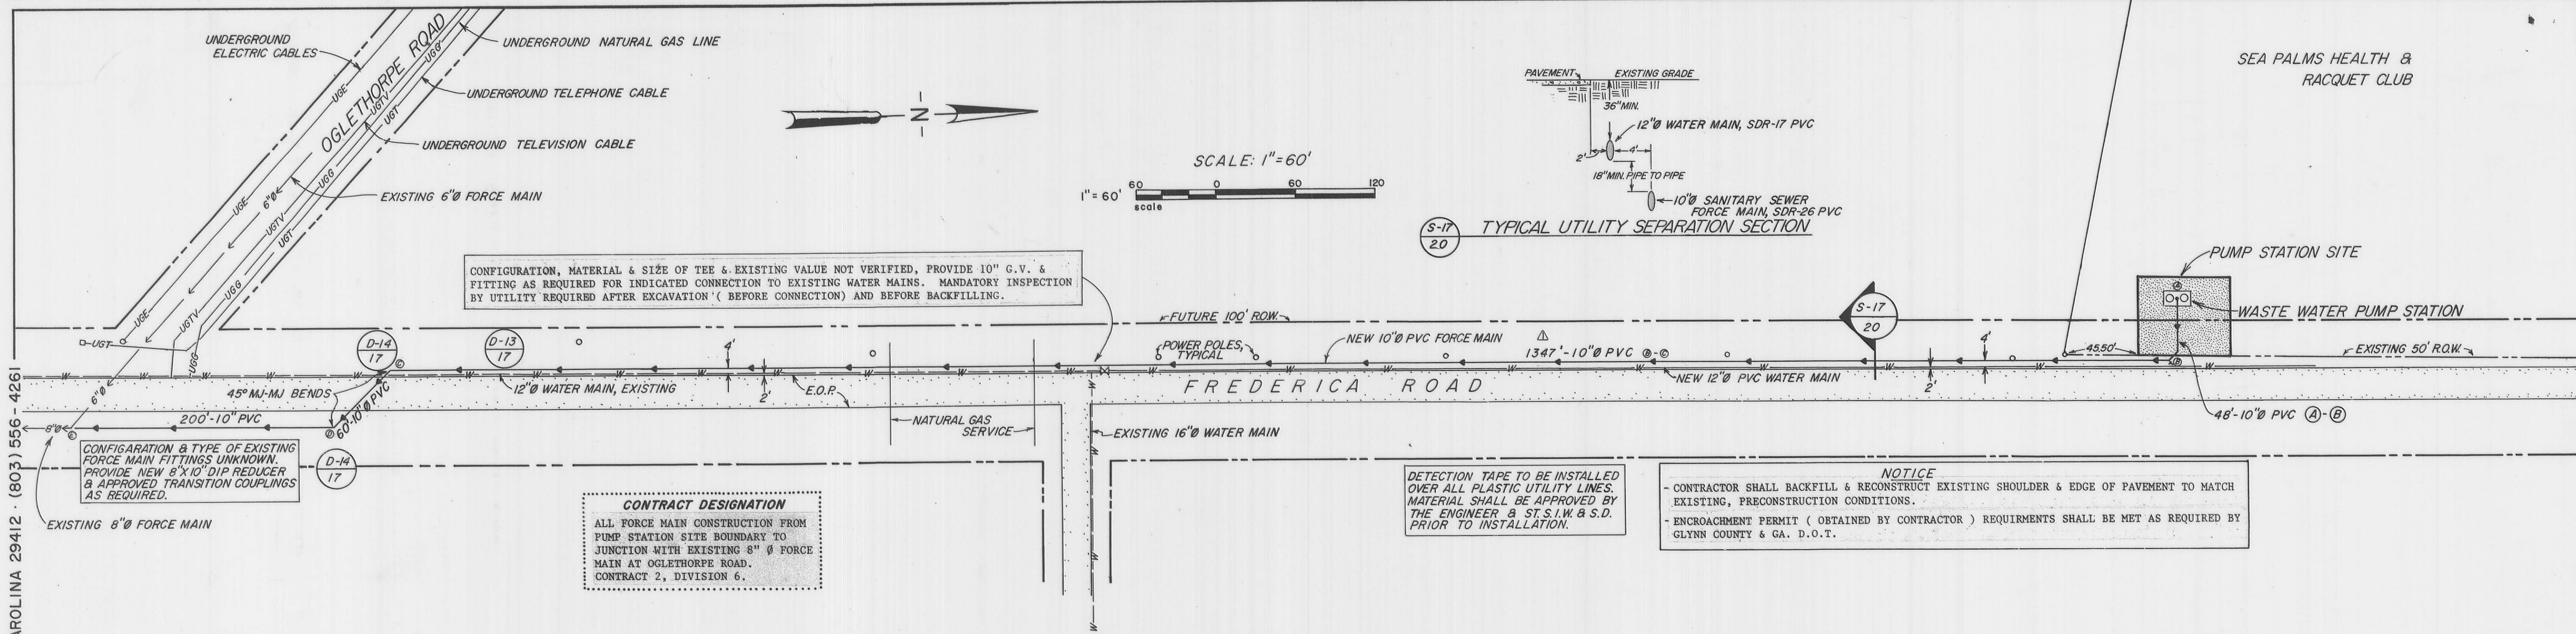

CONFIGURATION, MATERIAL & SIZE OF TEE & EXISTING VALUE NOT VERIFIED, PROVIDE 10" G.V. & FITTING AS REQUIRED FOR INDICATED CONNECTION TO EXISTING WATER MAINS. MANDATORY INSPECTION BY UTILITY REQUIRED AFTER EXCAVATION (BEFORE CONNECTION) AND BEFORE BACKFILLING.

CONFIGURATION & TYPE OF EXISTING FORCE MAIN FITTINGS UNKNOWN. PROVIDE NEW 8"X10" DIP REDUCER & APPROVED TRANSITION COUPLINGS AS REQUIRED.

CONTRACT DESIGNATION
ALL FORCE MAIN CONSTRUCTION FROM PUMP STATION SITE BOUNDARY TO JUNCTION WITH EXISTING 8" Ø FORCE MAIN AT OGLETHORPE ROAD.
CONTRACT 2, DIVISION 6.

DETECTION TAPE TO BE INSTALLED OVER ALL PLASTIC UTILITY LINES. MATERIAL SHALL BE APPROVED BY THE ENGINEER & ST.S.I.W. & S.D. PRIOR TO INSTALLATION.

NOTICE
- CONTRACTOR SHALL BACKFILL & RECONSTRUCT EXISTING SHOULDER & EDGE OF PAVEMENT TO MATCH EXISTING, PRECONSTRUCTION CONDITIONS.
- ENCROACHMENT PERMIT (OBTAINED BY CONTRACTOR) REQUIREMENTS SHALL BE MET AS REQUIRED BY GLYNN COUNTY & GA. D.O.T.

SEA PALMS HEALTH & RACQUET CLUB

PUMP STATION SITE

WASTE WATER PUMP STATION

EXISTING 50' R.O.W.

48'-10"Ø PVC (A)-(B)

FREDERICA ROAD

EXISTING 16"Ø WATER MAIN

NATURAL GAS SERVICE

POWER POLES TYPICAL

FUTURE 100' ROW

NEW 10"Ø PVC FORCE MAIN

NEW 12"Ø PVC WATER MAIN

1347'-10"Ø PVC @-@

200'-10" PVC

45° MJ-MJ BENDS

EXISTING 6"Ø FORCE MAIN

UGTV

UGT

UGT

UGT

UGT

UGT

UGT

UGT

UGT

TITLE
OFF-SITE SANITARY SEWER
FORCE MAIN
SEA PALMS HEALTH & RACQUET CLUB
SEA PALMS WEST
ST. SIMONS ISLAND, GA.

SEA PALMS DEVELOPMENT CORP.

DESIGNED BY:
G. R. GEORGE
DRAWN BY:
K
JOB NO.:
337-
DATE:
MARCH 1983
SHEET
20

5/26/83 REVISE PIPE LENGTH