

TOP PLAN

GENERAL NOTES

WATER METER TO BE PURCHASED FROM THE BRUNSWICK - GLYNN JOINT WATER & SEWER COMMISSION (JWSC). THE OWNER WILL PAY ALL COSTS FOR THE PURCHASE OF THE METER FROM JWSC AS WELL AS ALL ASSOCIATED CONNECTION AND ACCOUNT SET-UP FEES.

CONTRACTOR SHALL BE RESPONSIBLE FOR PICKUP AND DELIVERY OF THE METER FROM JWSC TO THE JOB SITE. CONTRACTOR SHALL ALSO BE RESPONSIBLE FOR WATER METER INSTALLATION INCLUDING ALL NECESSARY PIPE, VALVES, FITTINGS, ACCESSORIES, AND ALL OTHER WORK AND APPURTENANCES REQUIRED.

ALL FITTINGS TO BE DUCTILE IRON WITH FLANGED JOINTS. BURIED FITTINGS TO BE DUCTILE IRON WITH MECHANICAL JOINTS UTILIZING MEGA-LUG JOINT RESTRAINTS.


ALL DUCTILE IRON PIPE SHALL BE COATED WITH A BITUMINOUS COATING WITH A MINIMUM THICKNESS OF 2 MILLS OR WRAPPED IN PLASTIC.

TRANSMITTER FOR THE WATER METER SHALL BE LOCATED AS DIRECTED BY THE JWSC INSPECTOR.

BYPASS VALVE WILL REMAIN IN THE CLOSED POSITION AT ALL TIMES.

METER TO BE HOUSED IN A "HOT BOX" ENCLOSURE OR JWSC APPROVED EQUAL. ANCHOR ENCLOSURE WITH RED HEAD INSERTS AND 3/8" BOLTS.

INSTALL A LOCK TYPE TWO-PIECE VALVE BOX ON THE BY-PASS VALVE PER JWSC SPECIFICATION.

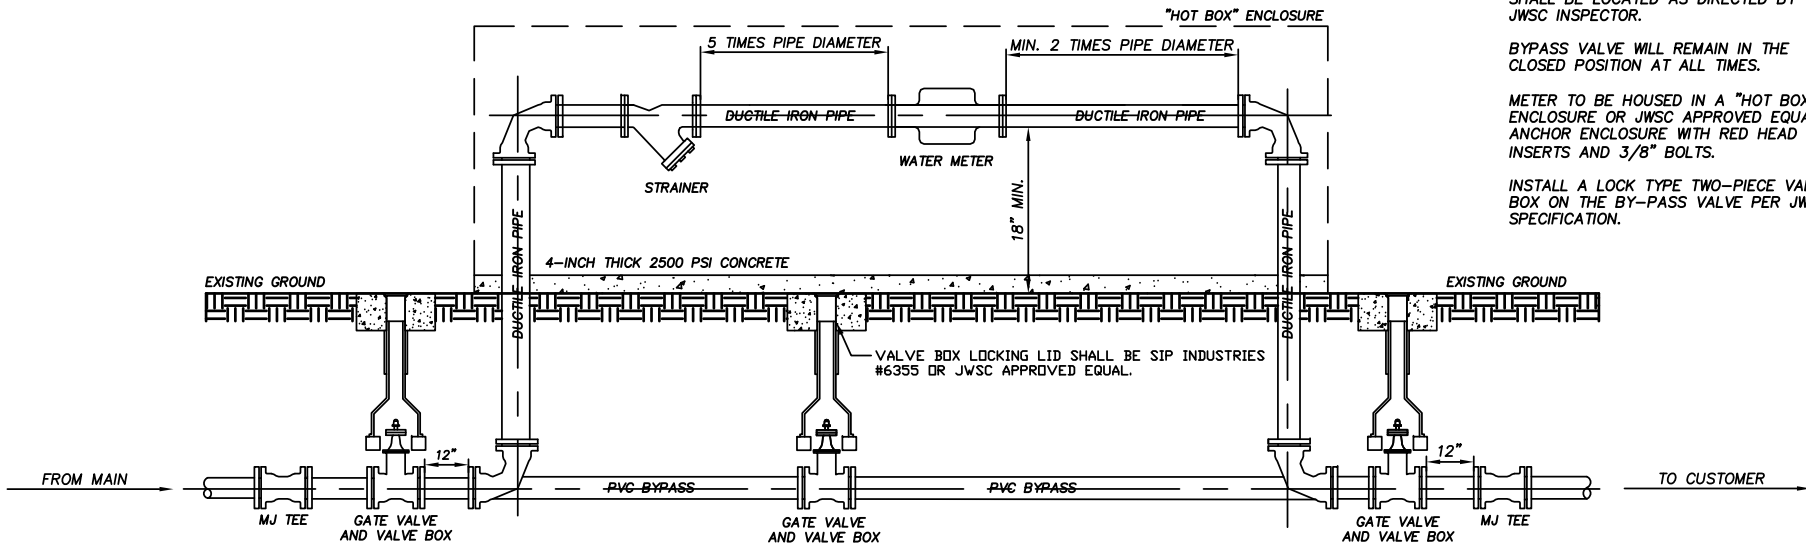

SECTION

NOT TO SCALE



BRUNSWICK-GLYNN COUNTY
JOINT WATER & SEWER
COMMISSION

1703 Gloucester Street Phone: (912) 261-7110
Brunswick, Georgia 31520 Fax: (912) 261-7178
Website: www.bgiwsc.org

ABOVE GRADE WATER METER INSTALLATION
DETAIL (3" & LARGER)

JWSC STANDARD DETAIL 2-25

Date: JANUARY 2016