



CONTRACTOR TO VERIFY BASED  
UPON DIMENSIONS OF STRAINER  
AND WATER METER

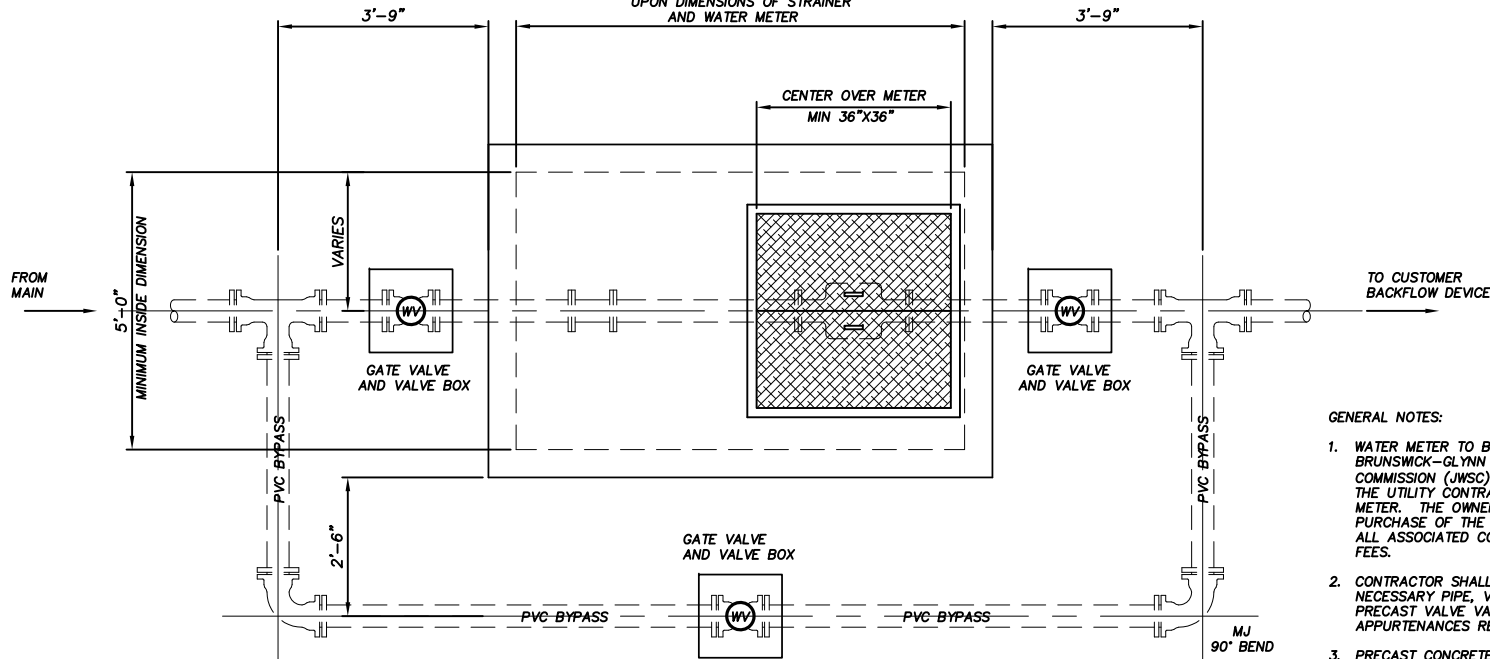

TOP PLAN

GENERAL NOTES:

1. WATER METER TO BE PURCHASED FROM THE BRUNSWICK-GLYNN COUNTY JOINT WATER AND SEWER COMMISSION (JWSC). THE JWSC WILL COORDINATE WITH THE UTILITY CONTRACTOR AND WILL INSTALL THE METER. THE OWNER WILL PAY ALL COSTS FOR THE PURCHASE OF THE METER FROM JWSC AS WELL AS ALL ASSOCIATED CONNECTION AND ACCOUNT SET-UP FEES.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL NECESSARY PIPE, VALVES, FITTINGS, ACCESSORIES, PRECAST VALVE VAULT AND ALL OTHER WORK AND APPURTENANCES REQUIRED.
3. PRECAST CONCRETE VALVE VAULT TO BE IN ACCORDANCE WITH ASTM C-478. A FACTORY INSTALLED 10MM BITUMASTIC COATING IS REQUIRED.
4. ALL INTERIOR FITTINGS TO BE DUCTILE IRON WITH FLANGED JOINTS. BURIED FITTINGS TO BE DUCTILE IRON WITH MECHANICAL JOINTS UTILIZING MEGA-LUG JOINT RESTRAINTS.
5. TRANSMITTER FOR THE WATER METER SHALL BE LOCATED AS DIRECTED BY THE JWSC INSPECTOR.
6. ALUMINUM ACCESS COVER SHALL BE MODEL W13636 AS MANUFACTURED BY HALLIDAY PRODUCTS INC. OR APPROVED EQUAL. BEFORE THE VAULT IS DELIVERED TO THE SITE, THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FROM THE VAULT MANUFACTURER FOR REVIEW.
7. THE Y STRAINER SHALL BE MANUFACTURED BY KECKLEY OR APPROVED EQUAL.

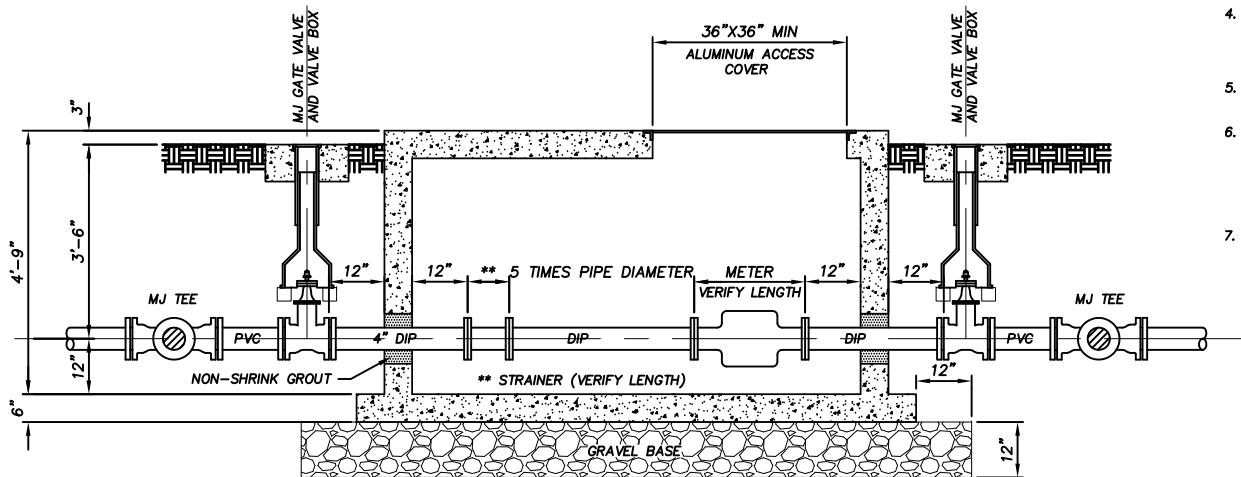

SECTION

NOT TO SCALE



BRUNSWICK-GLYNN COUNTY  
JOINT WATER & SEWER  
COMMISSION

1703 Gloucester Street Phone: (912) 261-7110  
Brunswick, Georgia 31520 Fax: (912) 261-7178  
Website: www.bgjwsc.org

WATER METER INSTALLATION  
DETAIL (3" & LARGER)

JWSC STANDARD DETAIL 2-19

Date: NOVEMBER 2018